

Familie Muster Mustermann

Kundennummer: 3

Musterstr.1

Telefon: 111111111

10000 Musterstadt


Fax: 111111112

Water Testing Water Quality Report

Identification:

Testing date: 07.08.2017

Culture: Brunnen ganz neu!

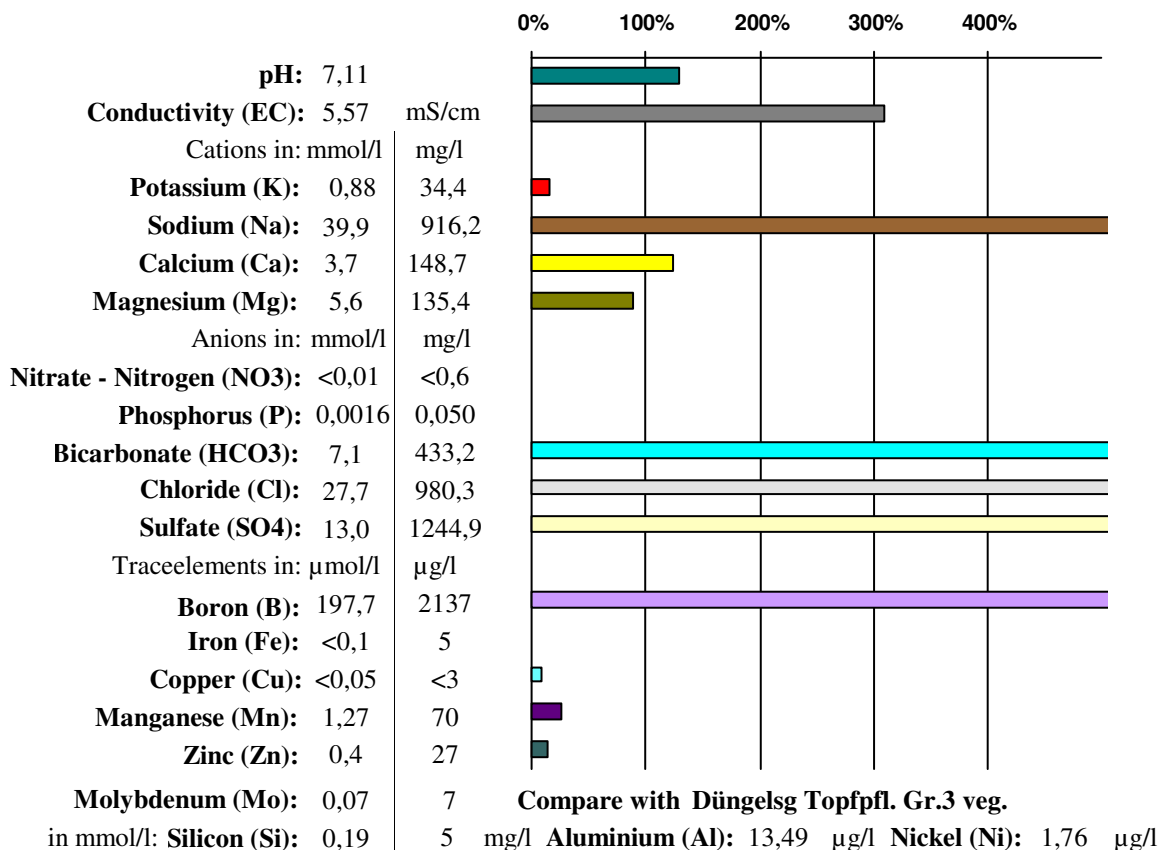

Compare with Düngelsg Topfpfl. Gr.3 veg.

Total Hardness: 52,0 °dH **Carbonate Hardness:** 19,9 °dH **Non carbonate Hardness:** 32,1 °dH
 not usable for irrigation! Too salty, much too high sodium, chloride, sulfates, boron!

For the analysis:

No liability shall be taken for all accounts of our recommendations for crops which may possibly occur damage, except for in the case of gross negligence or intent.